


C I R C U L A C I O N

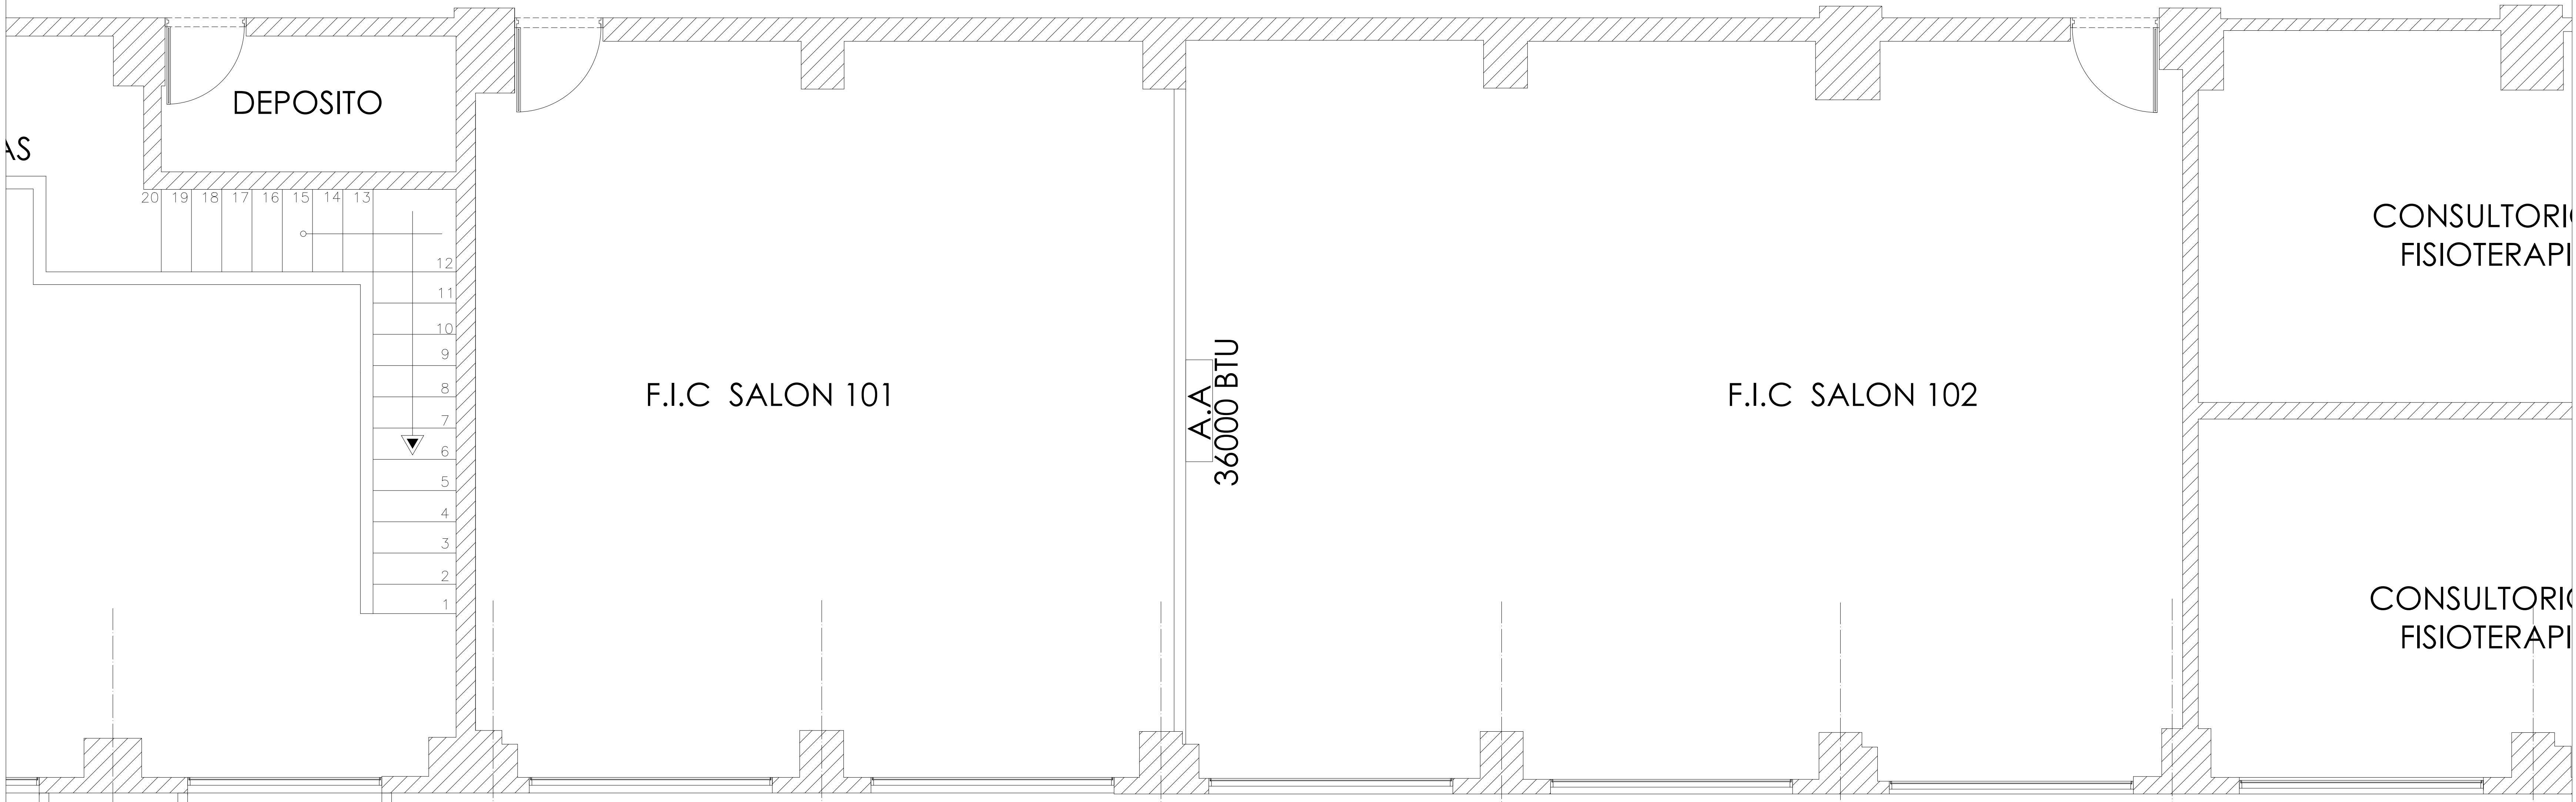

DEPOSITO

F.I.C SALON 101

F.I.C SALON 102

CONSULTORIO FISIOTERAPIA

CONSULTORIO FISIOTERAPIA

A.A  
36000 BTU

AS

3.90

3.31

3.50

3.49

3.50

3.40

3.70

F

G

H

I


J

K

L

M

C A R R E R A 2

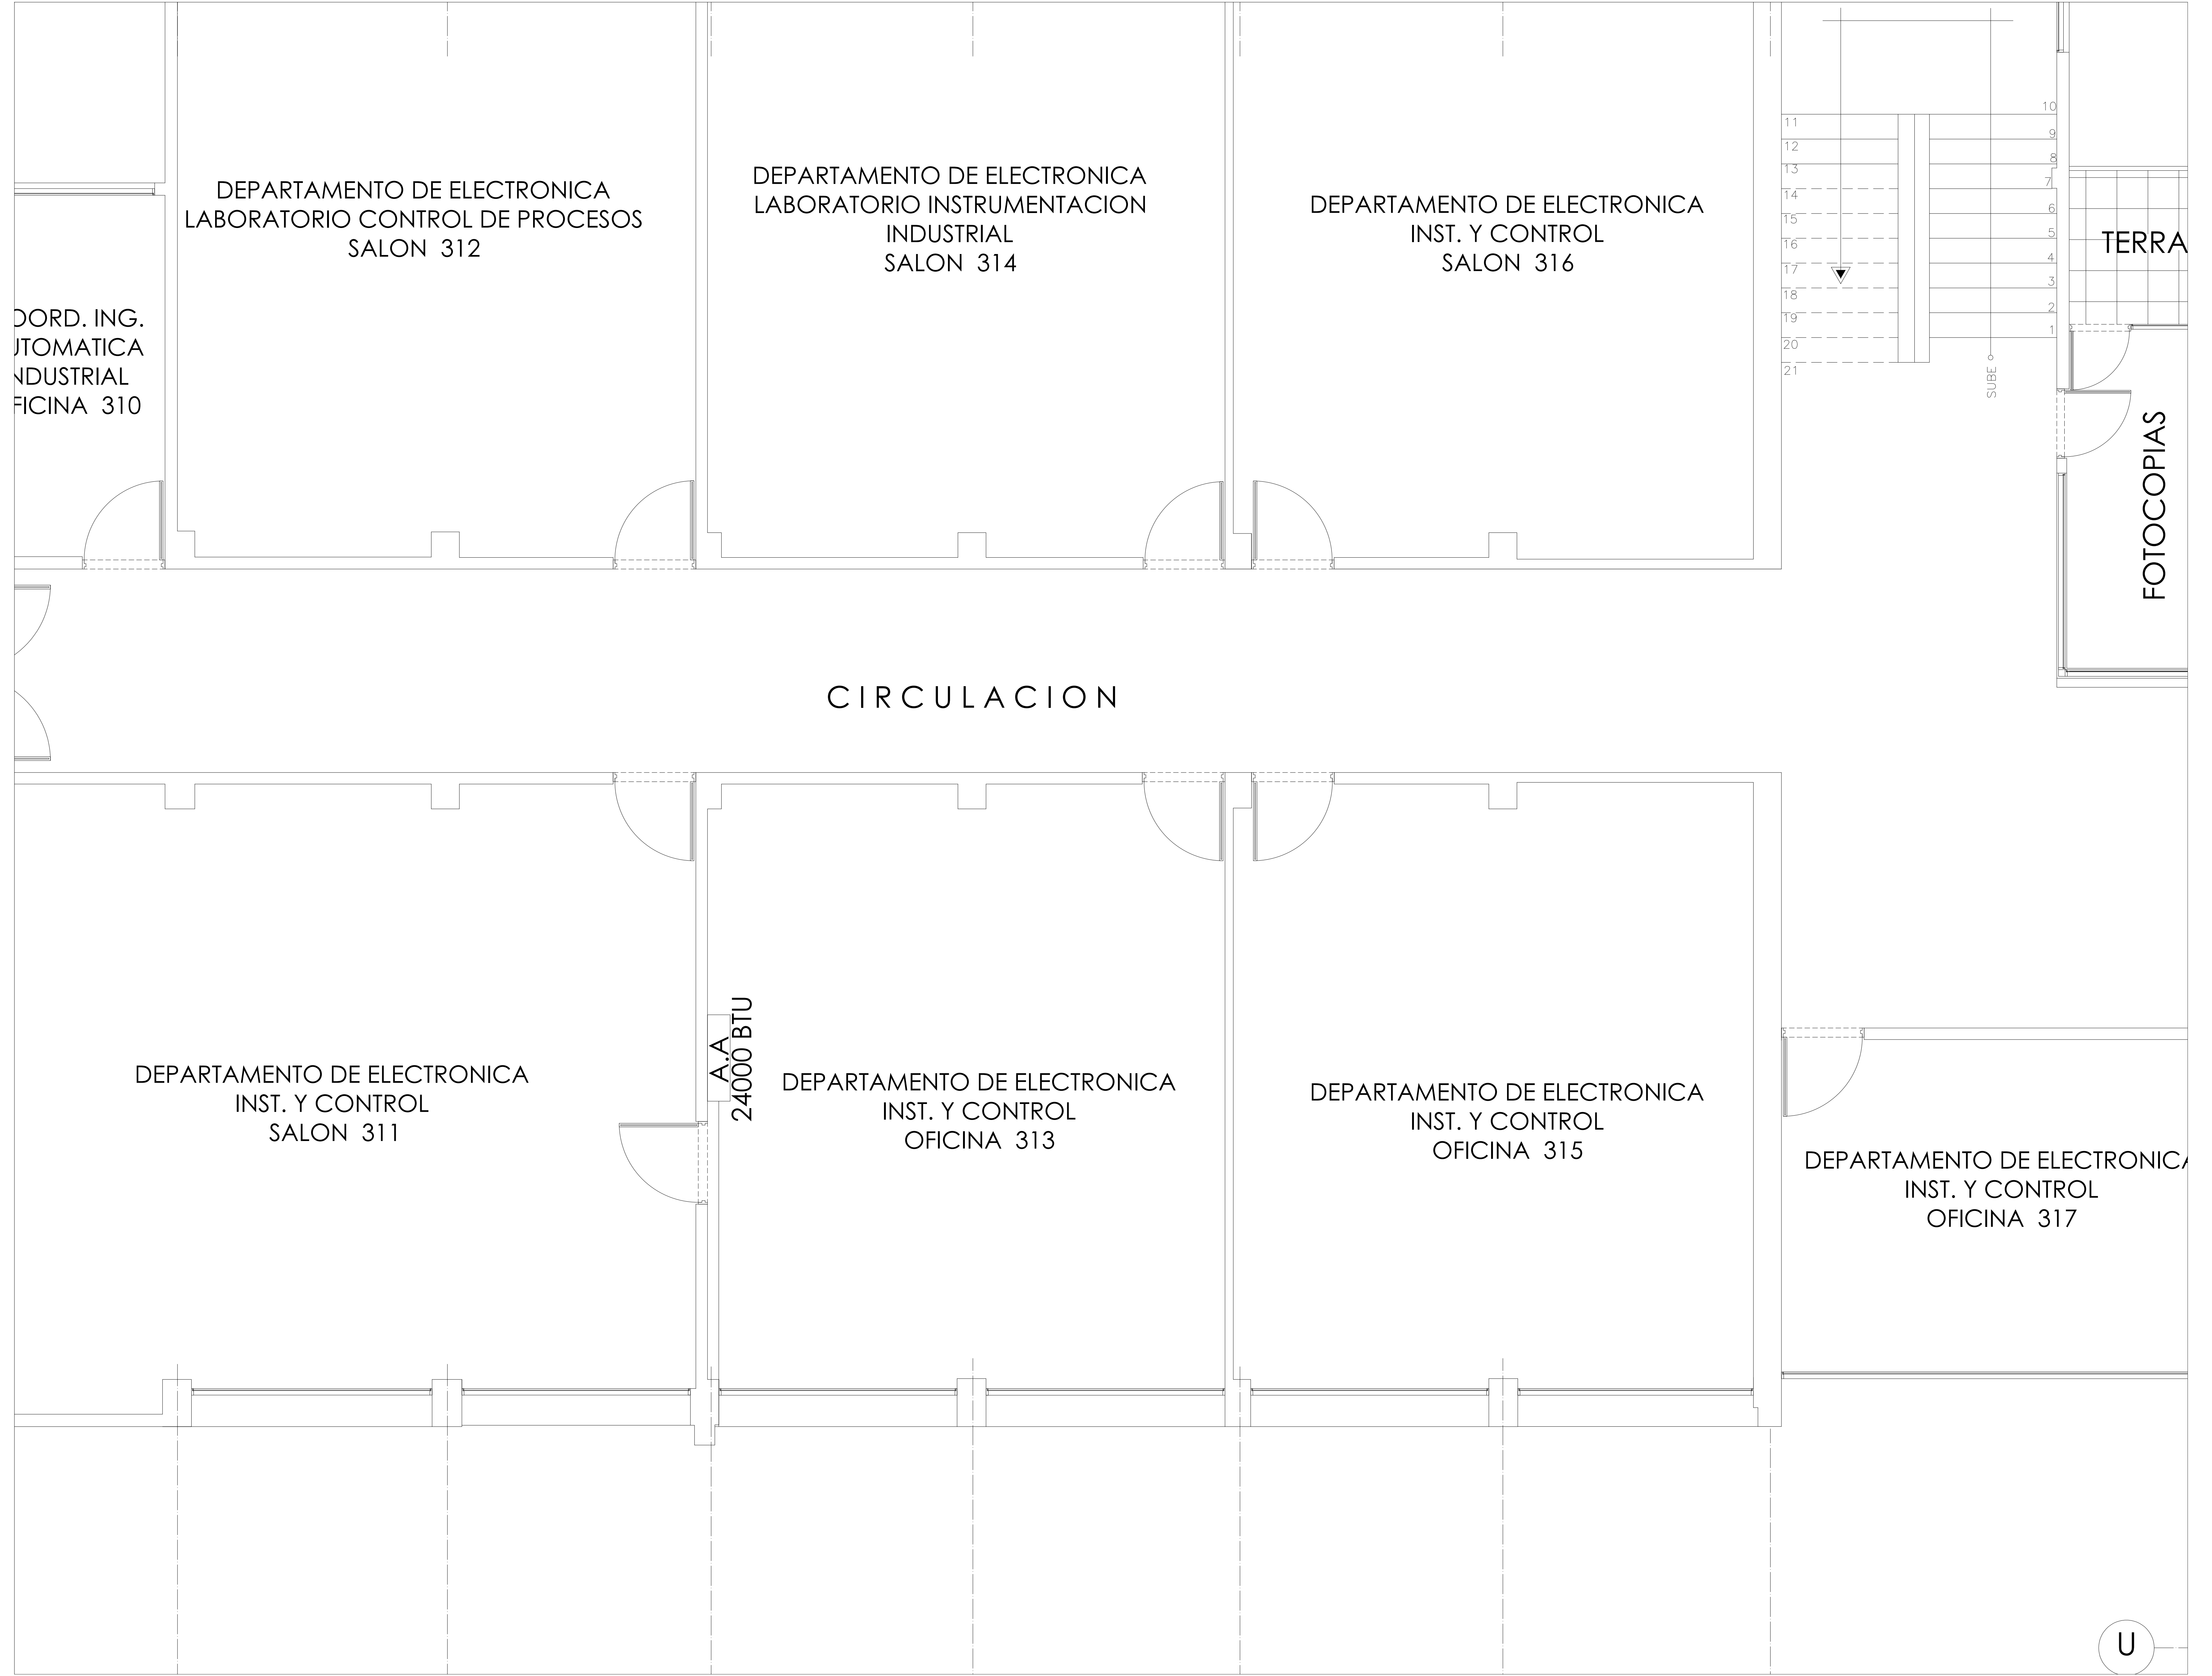

TERRAZA

FOTOCOPIAS

A.A.  
24000 BTU

SALON 318

WC HOMBRES

WC MUJERES

DEPARTAMENTO  
TELEMATICA  
OFICINA 322

CENTRAL DE  
CONMUTACION  
F.I.E.T  
SALON 324

F.I.E.T  
SALON 324

CIRCULACION

RONICA

GRUPO NUEVAS TECNOLOGIAS  
EN TELECOMUNICACIONES  
SALON 319

SALA WEB TELECOMUNICACIONE  
SALON 321

A.A.  
24000 BTU

FAC.ING. ELECT  
SALON 3

U

CENTRAL DE  
CONMUTACION  
F.I.E.T  
SALON 324

F.I.E.T  
SALON 324

F.I.E.T  
SALON 326

SALA DE AUDIOVISUAL  
TELEMATICA  
SALON 328

CIRCULACION

CIRCULACION

24000  
A.A.  
BTU

FAC.ING. ELECTRONICA  
SALON 323

36000  
A.A.  
BTU

ALMACEN

LABORATORIO DE SISTEMAS  
TELECOMUNICACIONES  
SALON 325

36000  
A.A.  
BTU

AUDIOVISUAL  
TELECOMUNICACIONES  
SALON 327

22

23

24


25


26

27

28

29

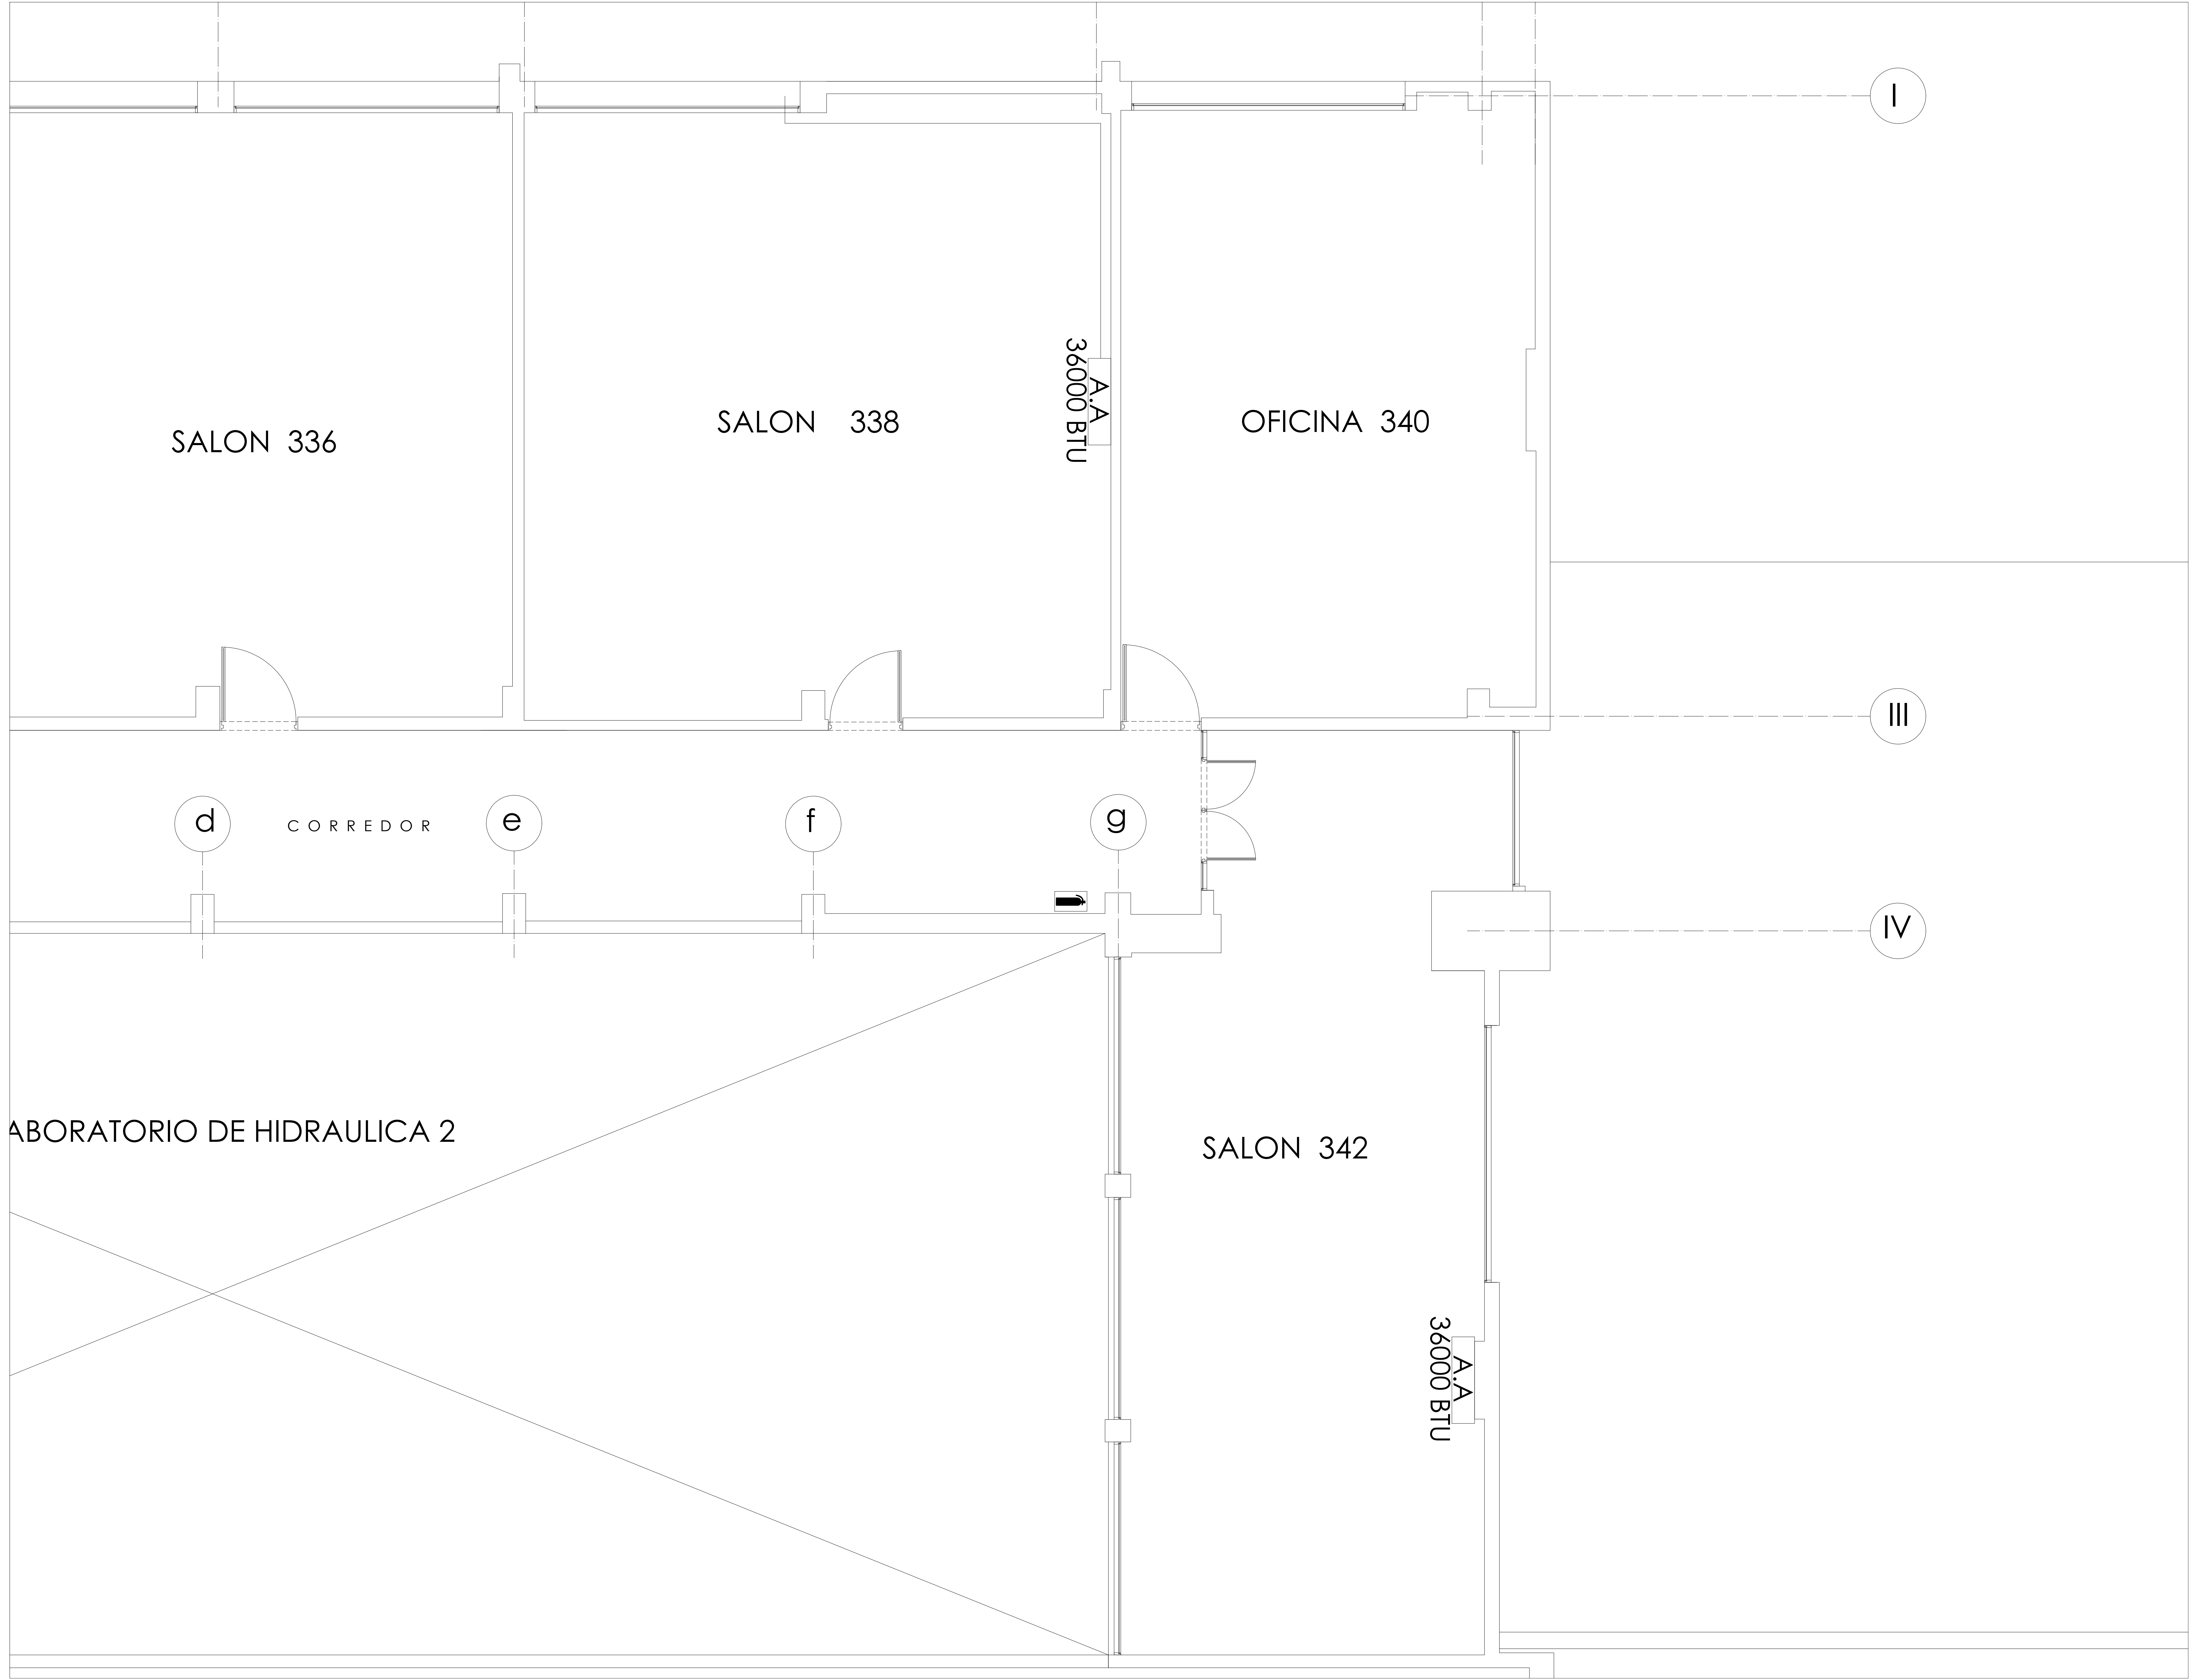

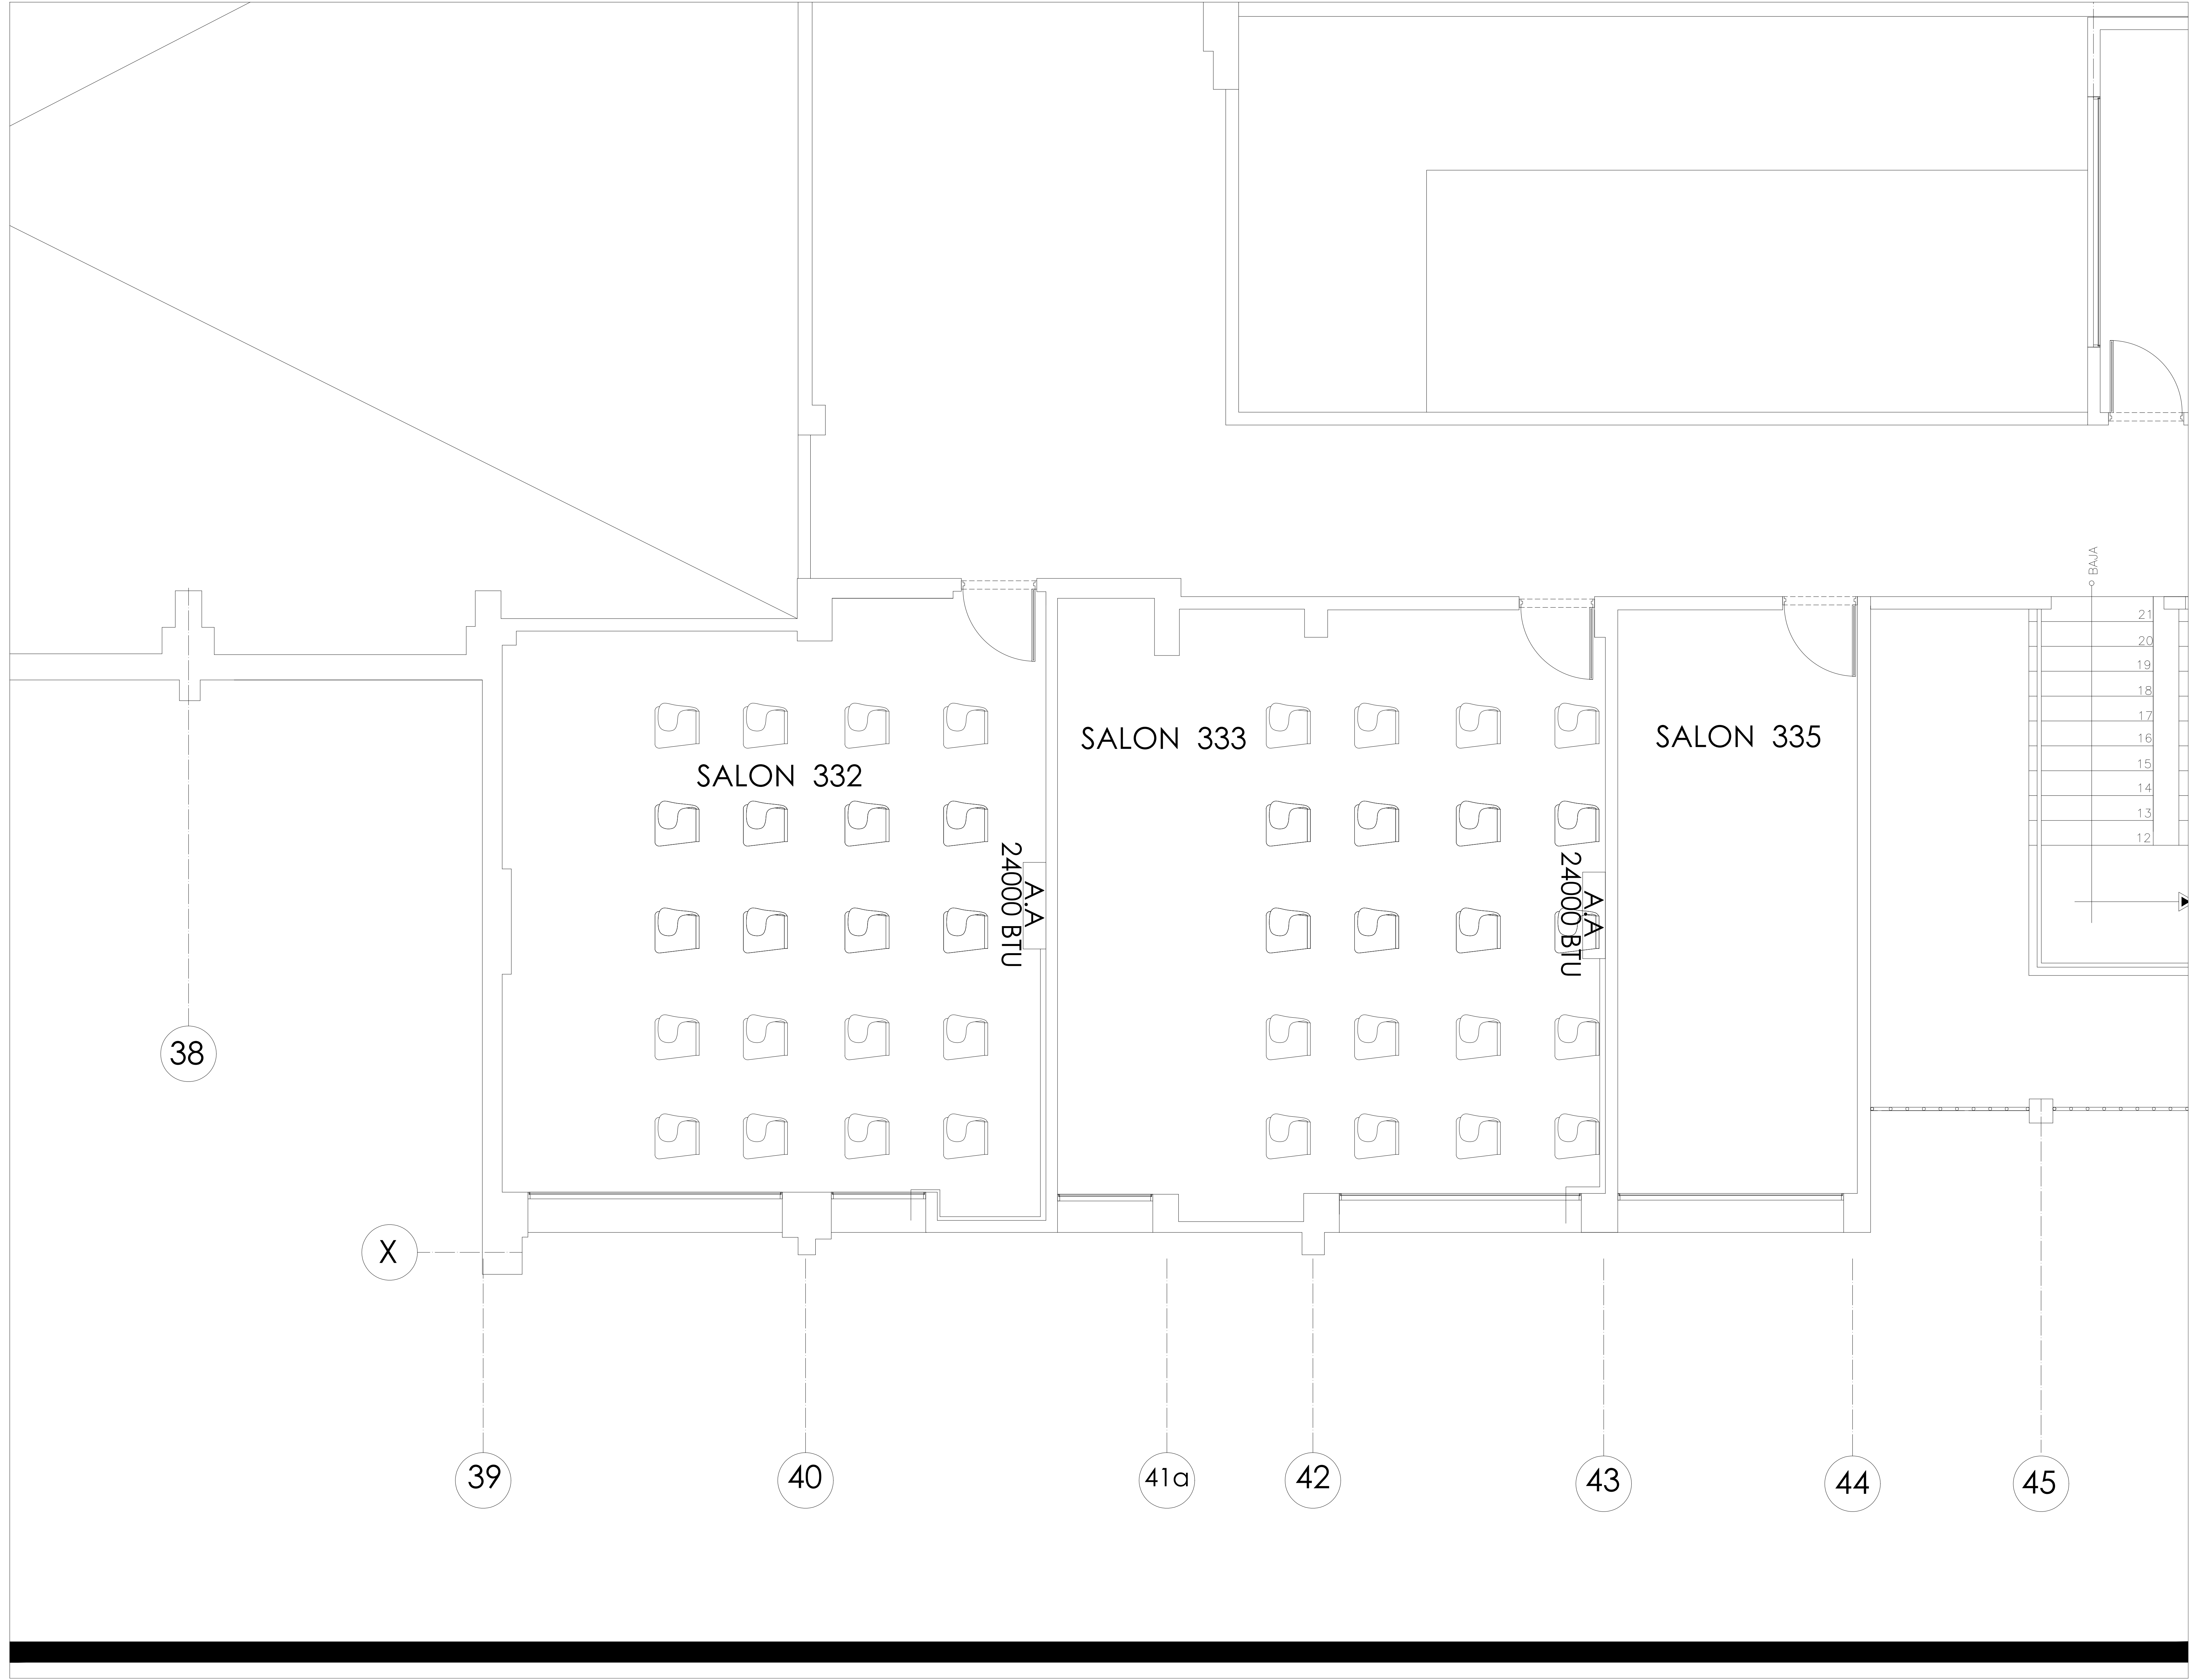

SALON 332

SALON 333

SALON 335

A.A.  
24000 BTU

A.A.  
24000 BTU

38

X

39

40

41a

42

43

44

45

21  
20  
19  
18  
17  
16  
15  
14  
13  
12

BAUJA